



*Tunnel photon water trademark registration Shuzou Arakaki®*

### *35th class services products*

*Contact us Japanese* TEL 090-1944-8672 responsible Arakaki

*Foreign language contact us by E-mail : ckm20400@star.odn.ne.jp*

Tunnel photon water 60 db (Gm0 preparation thousand times for dilution: deep sea water 1400m · Marine intermediate water 600m · Yanbaru forest of water) formulated water

How to use this site home page address URL <https://syuzou.awk.jp/>

## 1 components and How to use thousand-fold dilution use recommended

General bacteria (low temperature 21 °C) 0CFU / ml: general bacteria (low temperature 35 °C) 0CFU / ml: Coliform not detectable ND / 250ml: enterococci not detectable ND / 250ml: Pseudomonas aeruginosa not detectable ND / 250ml: spore-forming sulfite reducing anaerobic bacteria not detected ND / 250mJ: Salmonella not detectable ND / 250mJ: Shigella not detectable ND / 250mt: energy <1kcaVIOOg: moisture 99.9g / 100g

Protein <0.1g / 100g: lipid <0.1g / 100g: Carbohydrate <0.1g / 100g: ash content <0.1g / 100g: sodium □33.3mg / L Potassium <0.1mg / L: calcium <0.1mg / L: magnesium <0.001mg / L: pH value 7.8: Calcium magnesium, etc. (hardness) <0.5mg / L: iodine <0.05mg / L: phosphorus <0.001mg / L Tetsu <0.03mg / L: pot <0.001mg / L: Manganese <0.001mg / L: zinc <0.001mg / L: selenium <0.001mg / L

For Shelf Life: PET bottle number (yymmdd · B) is the expiration date 20YYMMDD depends on the ambient temperature storage resistance of PET bottles: 1000-fold dilution recommended: Please immediately available after opening: In the case of refrigerated storage 4 °C further 365 days : In the case of stored frozen -20 °C or less is even more possible extension of the expiration date. In transferred to the case sealed heat-resistant container of the expiration date a few days about cutting it is possible relish is heated sterilization 140 °C 15 minutes

### How to Use

For Shelf Life: PET bottle number (yymmdd · B) depends on the resistance at room temperature storage of PET bottles. The expiry date is 20YYMMDD: recommend the use of 1000-fold dilution: Please immediately available after opening: to enable the extension of the storage of further 365 days if the storage 4 °C in the refrigerator: save freezing -20 °C below It is possible extend the expiration date of a few years Furthermore, in the case of. If the expiration date a few days about cutting is possible shelf and been transferred instead to 140 °C 15 minutes heat sterilization in a sealed heat-resistant container


With the aim of convenience to the consumer about the product available under the trademark registration services 35 class

(<https://syuzou.awk.jp/Okinawa%20deep-ocean%20water%20technology/index.html>)

## 2 water intake and Three kinds of water Formulation

洋上設置型海洋深層水取水装置「海ヤカラ1号」は琉球海溝の手前、沖縄本島南方の水深1,750m余の海域に、設置されております。この装置は非常に小型ながら世界初の2層（1400m&600m）の深層水を湧昇させることが出来、小型船で取水していく方式であります。

洋上設置型海洋深層水取水試験装置「海ヤカラ1号」イメージ図

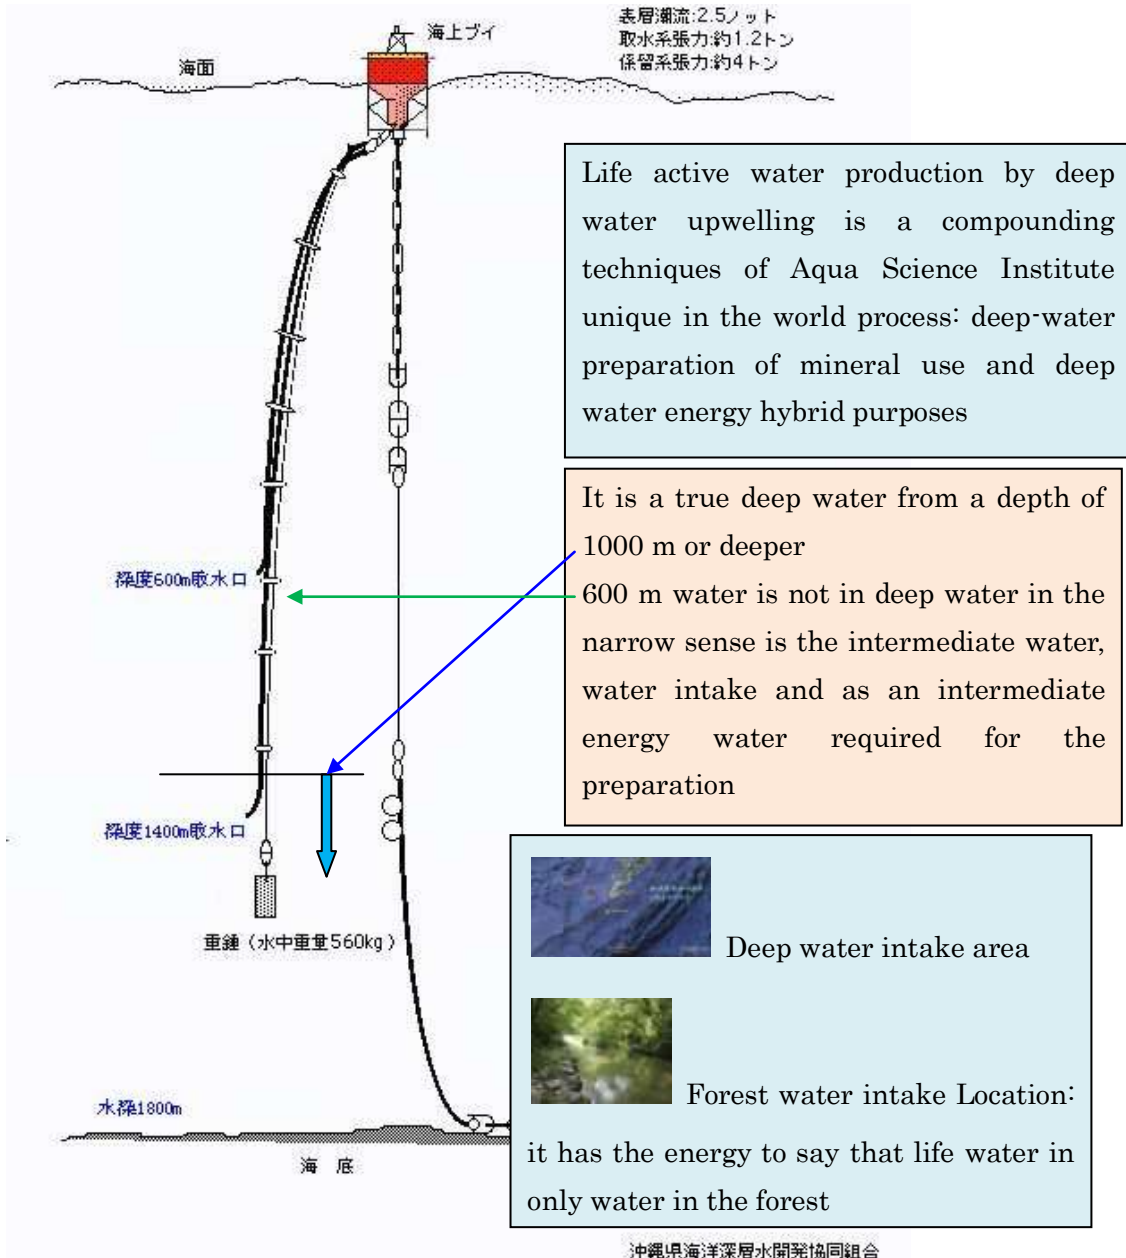

Aqua Science Institute (<http://aquascience.sakura.ne.jp/>) production of sister product similar diagram has been attached

Shuzou Arakaki <https://syuzou.awk.jp/Okinawa%20deep-ocean%20water%20technology/index.html>